


TERNA ENGINEERING COLLEGE

Design and Development of Solar Air Conditioning System for TEC Campus to Reduce Carbon Emission

Dr C M Choudhari, HoD, Mechanical Engineering Department, has successfully implemented Solar Air Conditioning System in his department. The same Solar Air Conditioning System will be implemented in campus of Terna Engineering College phase wise which will be helpful in cutting down carbon emission.


The demand for air conditioning is increasing due to the effects of climate change and global warming. If we still rely on conventional electric air conditioning it will be harmful in future because electricity is generated from fossil fuels, the greenhouse gas emission would continuously worsen global warming, and in turn the demand of air conditioning would be further increasing. Also the rate of electricity has increased by 8-10% which will continue increasing in the future. So in order to reduce global warming and the greenhouse gas emission effect we should adopt the renewable method for the generation of electricity which in turn reduces the cost of electricity by conventional way.

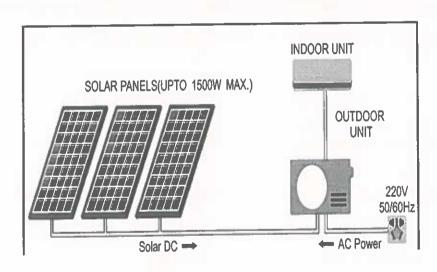



for blair and
PRINCIPAL


TERNA ENGINEERING COLLEGE Nerul, Navi Mumbai - 400 706. Therefore, this project focuses on the design and development of solar powered air-conditioning system. The solar energy is received by the PV module and transform into electrical energy. The electrical energy is then being regulated by charge controller. As the electrical energy coming from the PV module is in DC, inverter will convert it into AC as the compressor needs AC to operate. A solar on grid Air Conditioning system was designed for 3 Ton capacity. The solar Air Conditioning system required 18kwh/day, assuming 8 hours of continuous working.



These energy demands is fulfilled using 8 panels with generating capacity of 11.390kwh/day and the rest of the energy is supplied by grid as shown in following figure. After successful implementation of this project, we propose a similar system for entire engineering campus of TEC.

ENGINE AND COLLEGE OF THE COLLEGE OF

PRINCIPAL
TERNA ENGINEERING COLLEGE
Nerul, Navi Mumbai - 400 706.

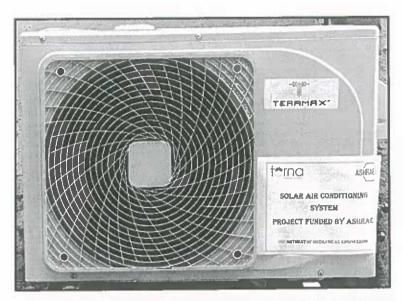

Photograph of implemented Solar Air Conditioning System


Total 45 conventional electric air conditioning units of 1 Ton capacity is available in campus. Cost per Ton of solar on grid Air Conditioning system is approximately Rs 1,40,000/-. Therefore the project cost for total 45 conventional electric air conditioning units of 1 Ton capacity replaced by solar on grid Air Conditioning system will be approximately Rs 63,00,000/-in TEC campus.

This will save large electricity consumption approximately by Rs 35,00,000/- per year. Therefore, Total cost invested will be recovered in two years span with green initiative. This will help to get 225mertric tons of Carbon Foot Print.

(0.02 metric tons:24 kWh of electricity at 0.85 kgCO2e/kWh)

PC7 GOLL

PRINCIPAL
TERNA ENGINEERING COLLEGE
Nerul, Navi Mumbai - 430 706.

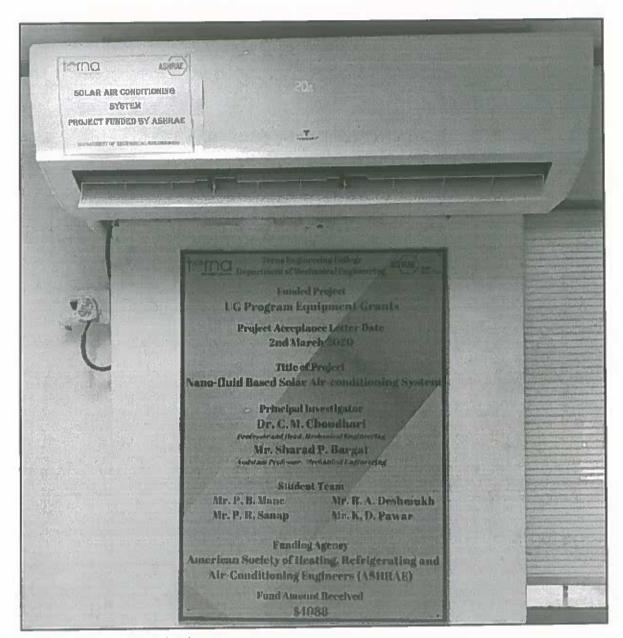

Carbon emission calculator



PRINCIPAL
TERNA ENGINEERING COLLEGE
Nerul, Navi Mumbai - 430 706.



相 伊 田 田 田 日



PRINCIPAL
TERNA ENGINEERING COLLEGE:
Nerul, Navi Mumbai - 400 706.